


NOTES

1. PHYSICAL SEPARATION MUST BE MAINTAINED AT ALL CONNECTION POINTS OF NEW OR REHABILITATED WATERMAINS TO THE EXISTING SYSTEMS UNTIL BACTERIOLOGICAL TESTS HAVE PASSED.
2. CONNECTION OF THE WATERMAIN TO BE COMPLETED AS PER COP WATER SERVICES CONSTRUCTION SPECIFICATIONS SECTION 2.4.19. ONLY AFTER RECEIPT OF AUTHORIZATION BY THE COP ENGINEER.
3. CONTRACTOR IS RESPONSIBLE FOR DESIGN, INSTALLATION AND MAINTENANCE OF THRUST BLOCKS THROUGHOUT CONSTRUCTION.
4. DEPRESSURIZATION POINT TO REMAIN OPEN WHENEVER STAFF ARE IN ACCESS PIT.
5. BACKFLOW TO BE SELECTED AND FIELD TESTED IN ACCORDANCE WITH CSA STANDARDS B64.10 AND B64.10.1
6. **UNRESTRAINED WATERMAIN UNDER PRESSURE IS NOT ALLOWED IN ACCESS PITS AT ANY TIME**
7. ADEQUATE RESTRAINT IS THE RESPONSIBILITY OF THE CONTRACTOR
8. ASSUME EXISTING WATERMAIN IS NOT RESTRAINED

N.T.S.

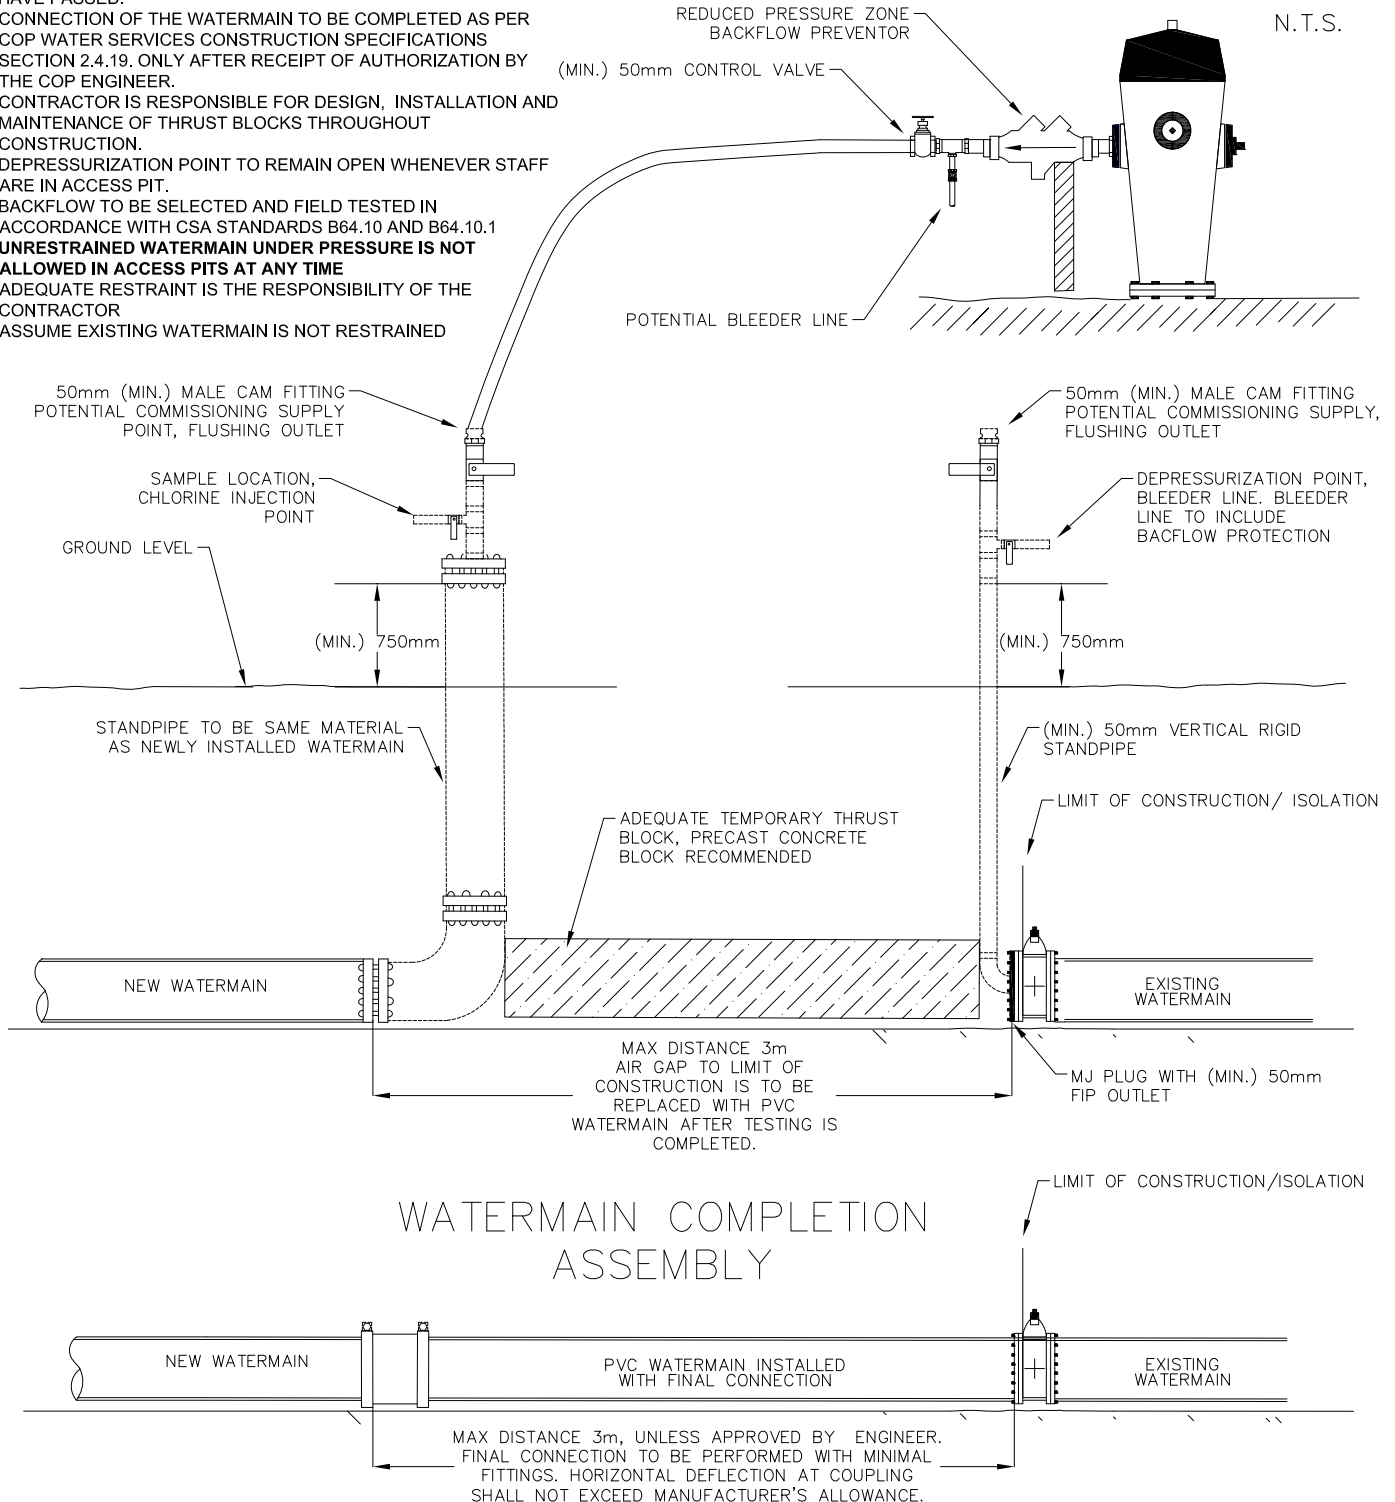

THE CITY OF PETERBOROUGH

STANDARD WATER SERVICES DRAWING

 TITLE	ALTERNATIVE POTABLE WATER SUPPLY FOR TESTING NEW, REPLACED AND LINED WATERMAIN		No.	REVISION	DATE
			1.	ADDED PIPE STANDS	01-11-2024
			2.	ADDED NOTE 6-8	01-15-2025
			3.	UPDATED TITLE BLOCK, REVISED NOTE 2	11-18-2025
DRAWN BY: J. ELLISON		APPROVED: K. CONLIN		A3085	
DESIGNED: J. ELLISON		DATE: 02-12-2019			